


## THE ROCK SEWERAGE TREATMENT WORKS

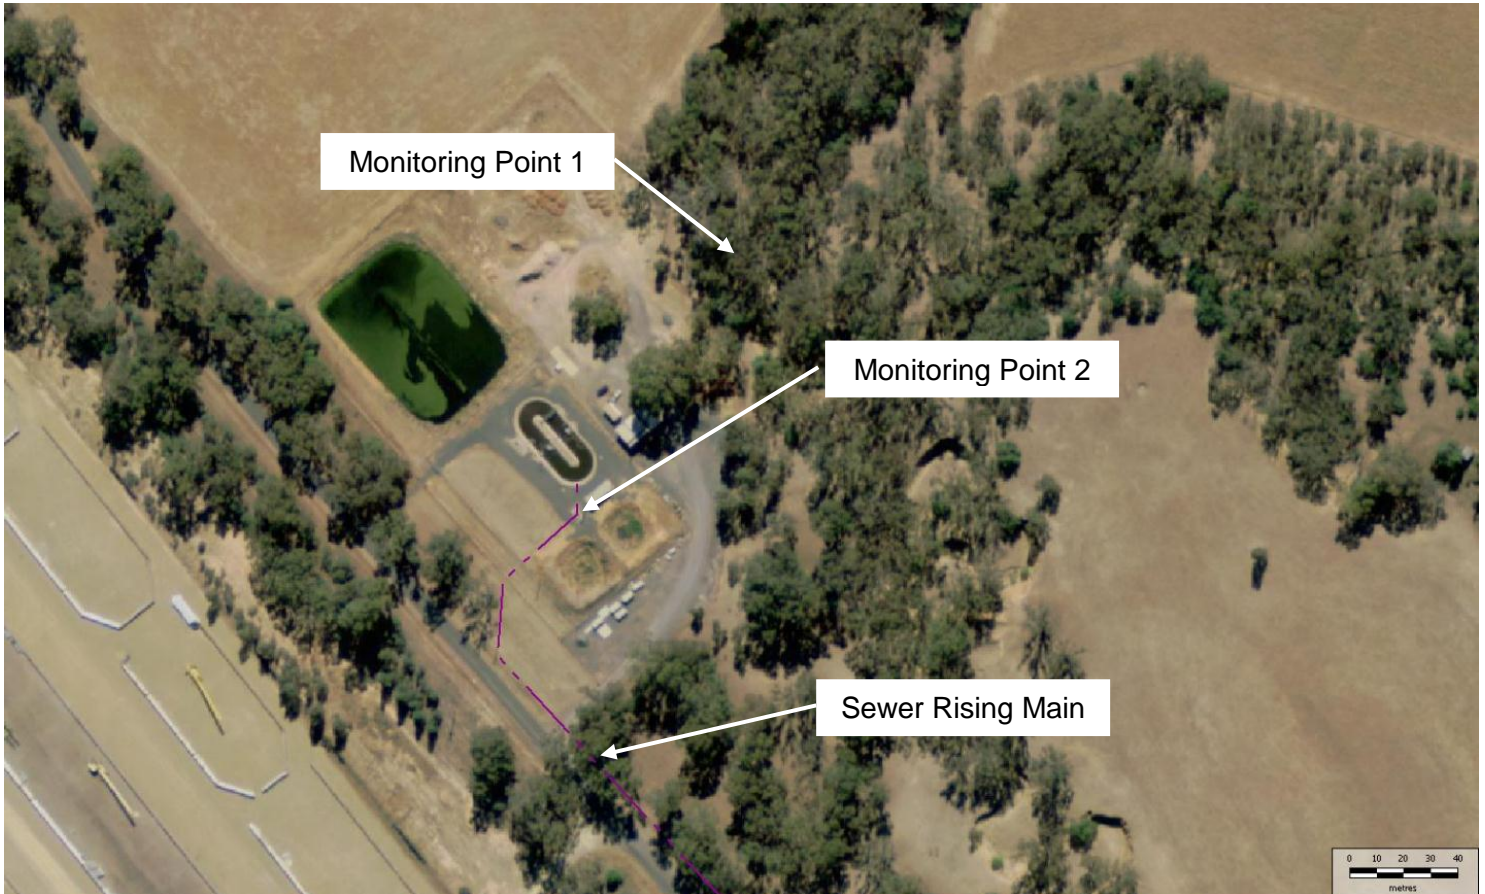

### Monitoring Point 1

Location: Flow meter at the Sewerage Treatment Works

Obtained: Daily

Sampled: Ongoing

Item	Unit	Frequency	Volume Limit
Daily Flow	KL/day	Daily	500

### Monitoring Point 2

Location: Sampling area at point of discharge into Burkes Creek

Obtained: Every 80 days

Sampled: Ongoing

Item	Unit	Frequency	Volume Limit
Biochemical Oxygen Demand	Mg/L	80 days	20
Residual Chlorine	Mg/L	80 days	
Faecal Coliforms	CFU/100ml	80 days	
Conductivity	uS/cm	80 days	
Total Nitrogen	Mg/L	80 days	
Nitrite/Nitrate	Mg/L	80 days	
Oil & Grease	Mg/L	80 days	10
Phosphorus	Mg/L	80 days	
pH	Mg/L	80 days	
Total Keldahl Nitrogen	Mg/L	80 days	
Total Suspended Solids	Mg/L	80 days	30